

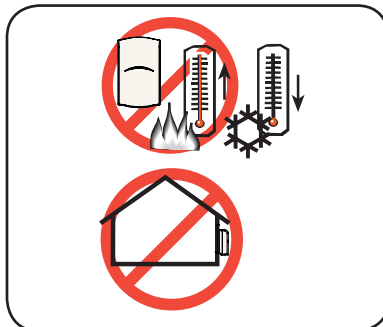




ISW-BRL1-WX (868 MHz)
ISW-BRL1-WY (915 MHz)

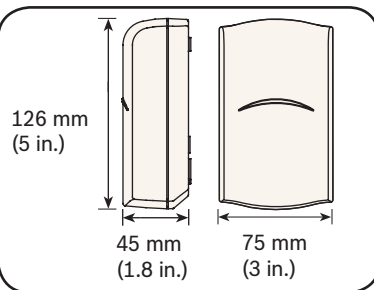


wLSN Relay Module Installation Instructions

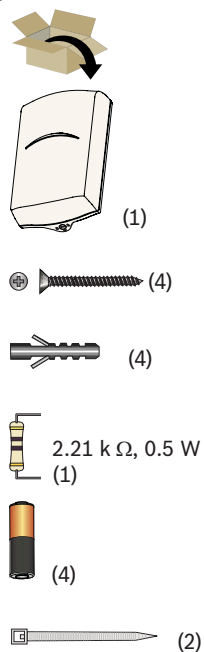

1

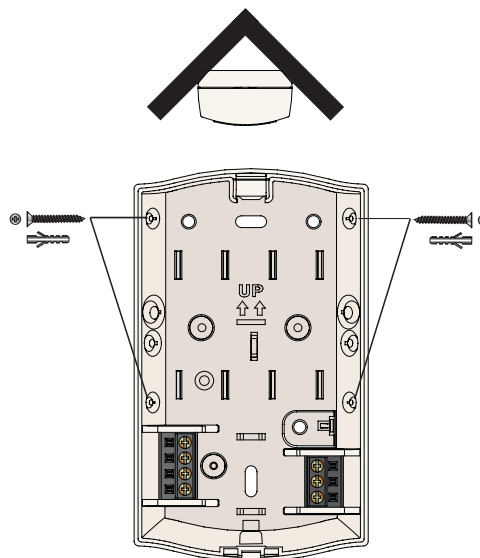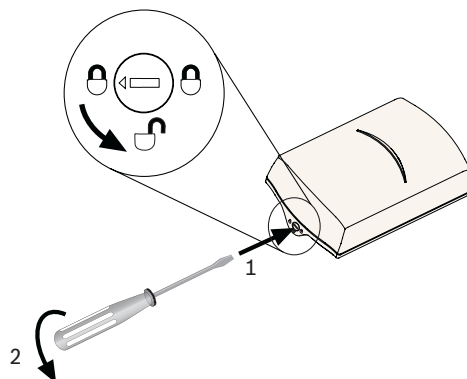


2

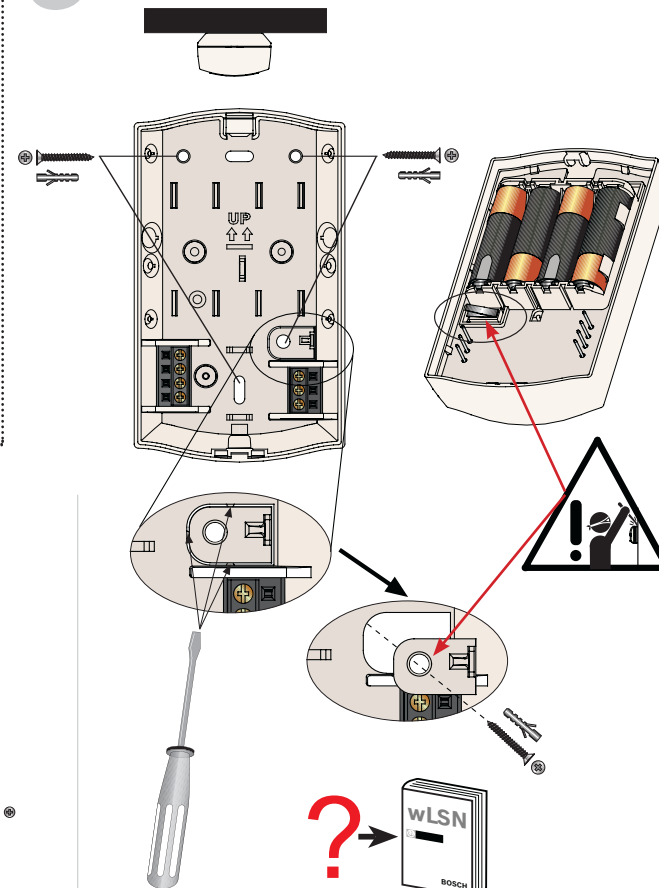


www.boschsecurity.com

© 2007 Bosch Security Systems, Inc.
F01U009264-01


3

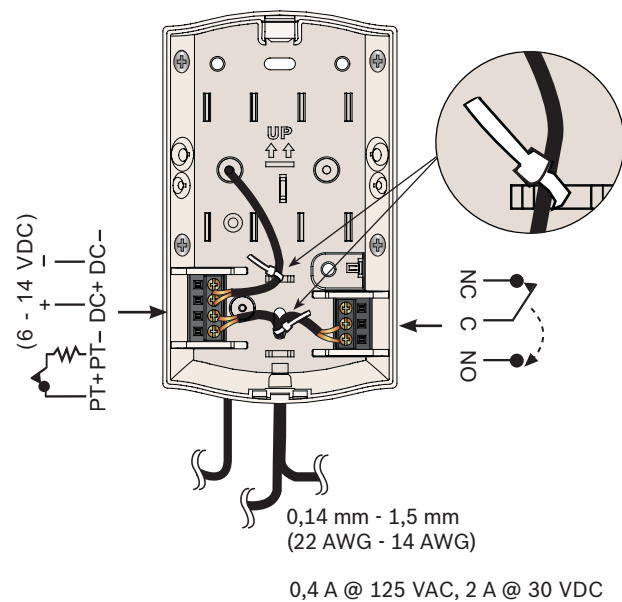


4

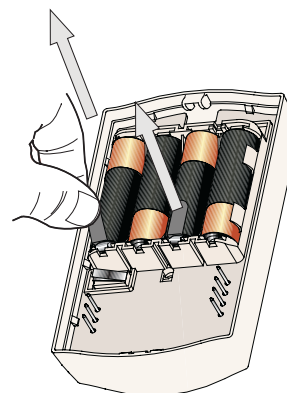

5

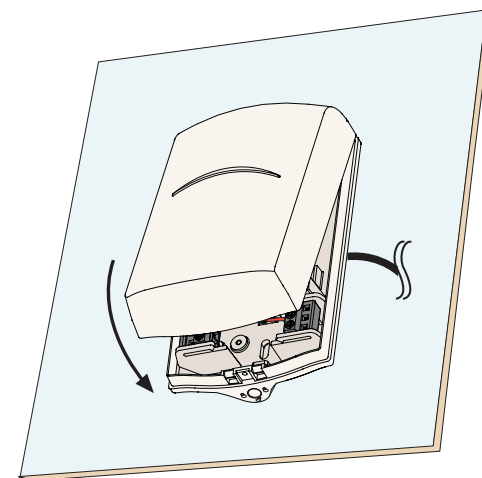

6

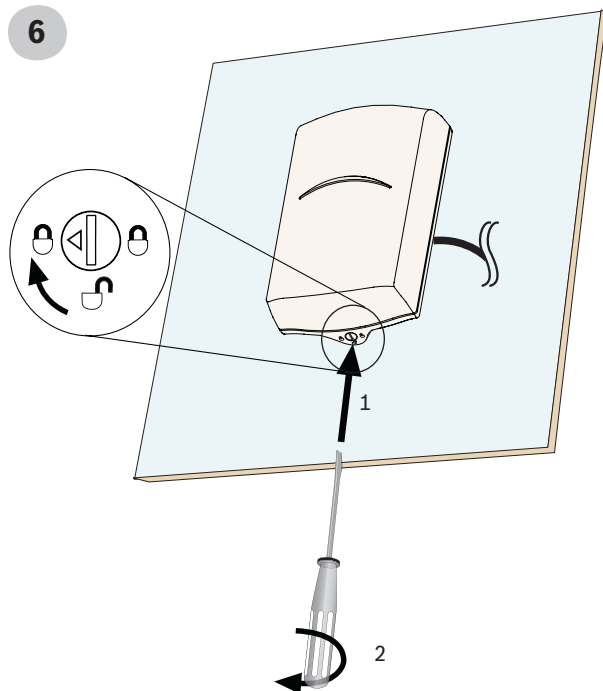

-10°C - +55°C (+14°F - +131°F)



<90%



868 MHz (ISW-BRL1-WX)
915 MHz (ISW-BRL1-WY)

ISW-BRL1-WX (868 MHz):



EN50131-1 Grade 2
Environmental Class II

ISW-BRL1-WY (915 MHz):

FCC, Part 15

IC: Industry Canada RSS-210

UL634: Standard for Connectors and Switches for Use with Burglar Alarm Systems

ULC C634-M1986: Standard for Connectors and Switches for Use with Burglar Alarm Systems

© 2007 Bosch Security Systems, Inc.
F01U009264-01

